




Electrical Information

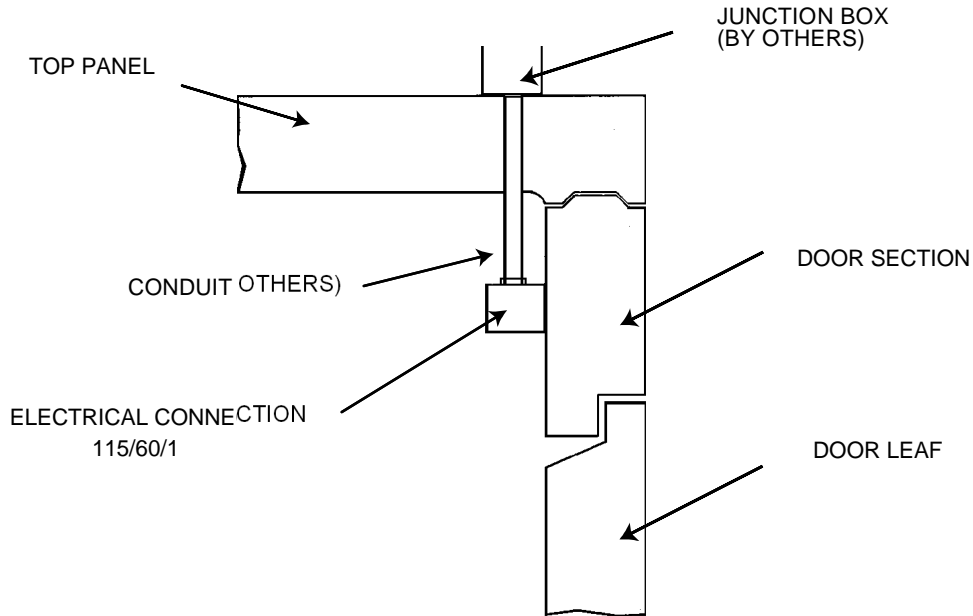

Conduit must be vapor sealed both inside and outside with an approved sealant.

DOOR ELECTRICAL CONSIDERATIONS

DOOR SIZE*	LIGHT	DOOR HEATER	DIGITAL THERMOMETER	VISION PORT	PRP (Separate Hook Up)
ALL SIZES	100 WATT MAX.	1.06 AMPS	12 VOLTS	.6 AMPS	.2 AMPS

*All door voltage is 120V/60/1 phase. Door size may vary, but all use the same lights, door heater, digital thermometer, vision port, and PRP. The number of each can vary by cooler.